


Example Only- Do not use this restraint detail for your explosion venting job. Contact us so that we can help suggest the best layout for your job.

Drawing # CD-004

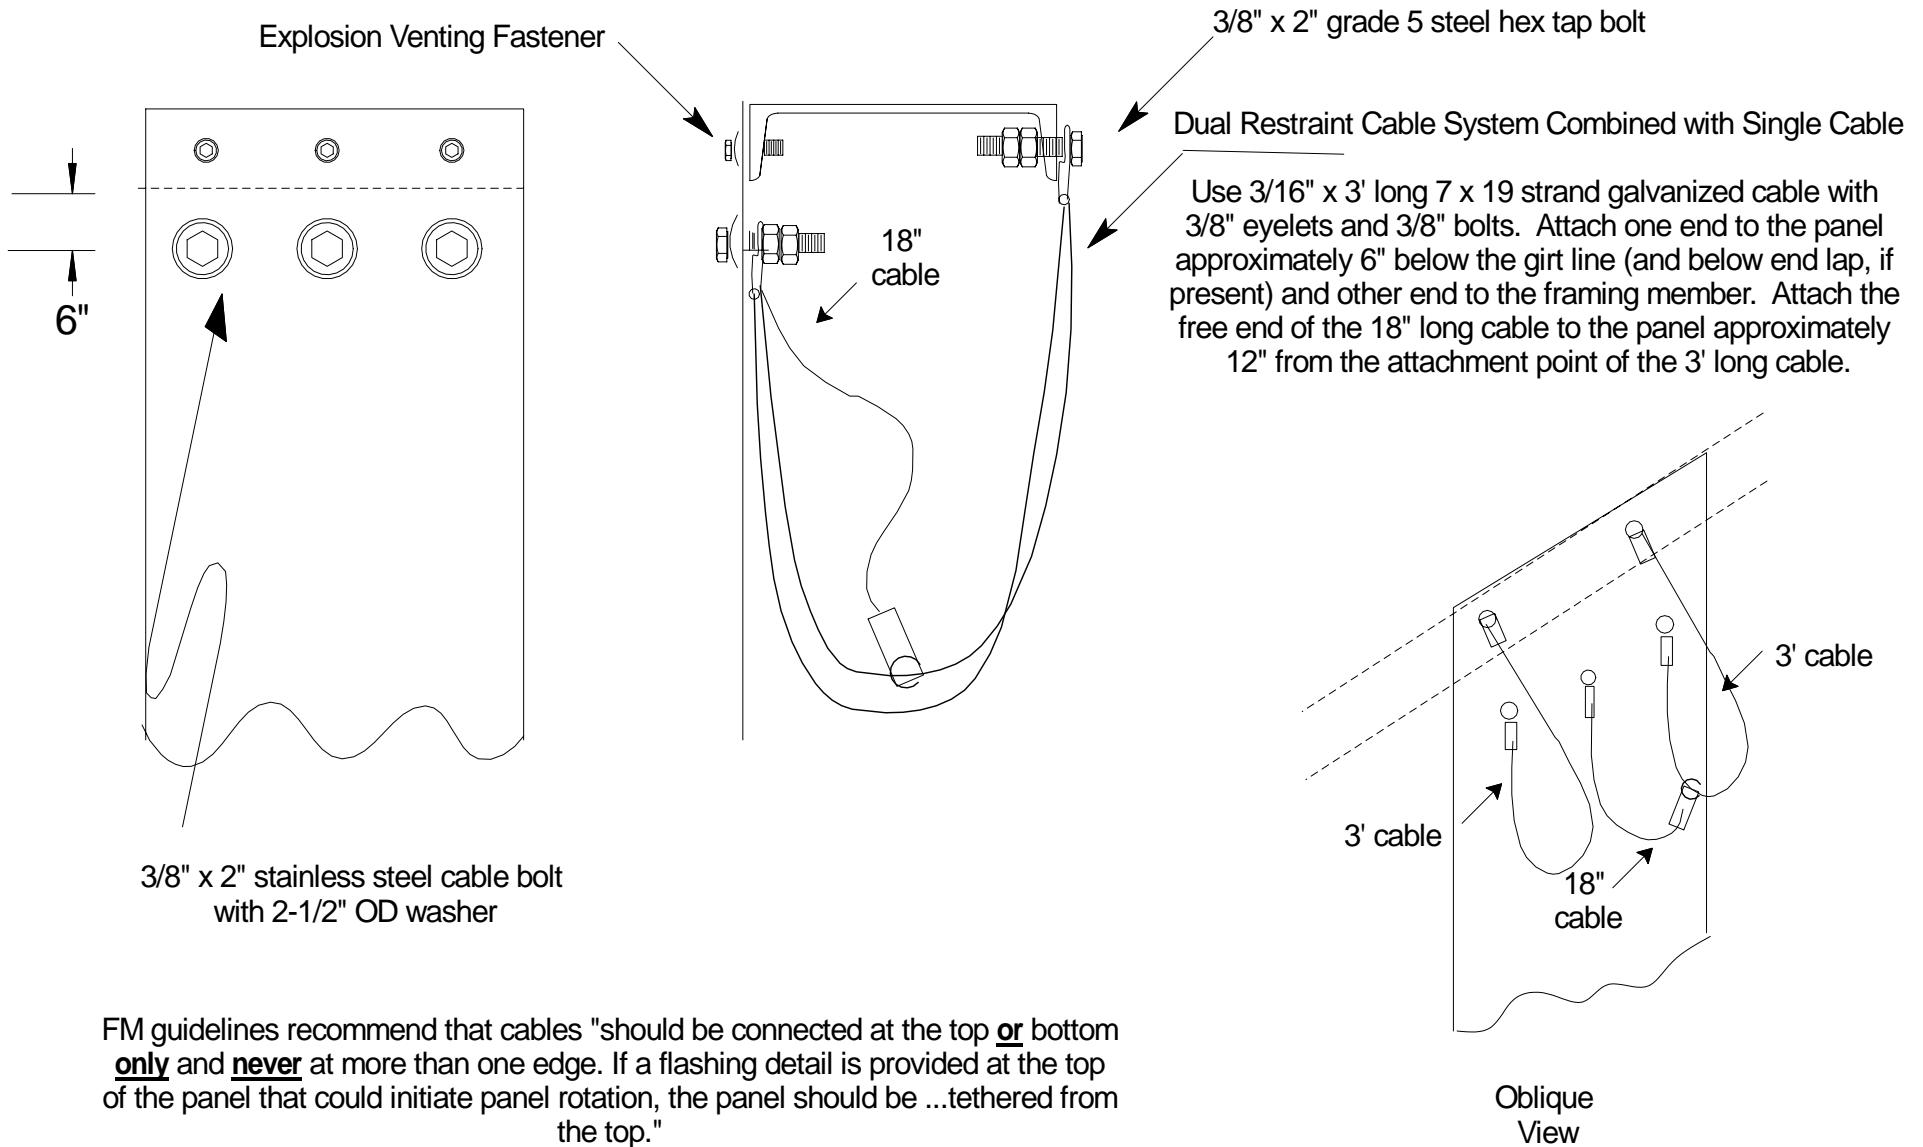

FM guidelines recommend that cables "should be connected at the top or bottom only and never at more than one edge. If a flashing detail is provided at the top of the panel that could initiate panel rotation, the panel should be ...tethered from the top."

This drawing is submitted for your approval as the suggested cable detail for your explosion venting panel. The drawing is based upon limited design criteria furnished to us by you and should be reviewed and approved by design engineers who have full disclosure on matters concerning this building.

Drawing # CD-004

Restraint Cable Detail
Dual Cable System Combined with Single Cable

Light Gage Single Skin Panel
 Up To 66 Square Feet
 3' Wide and Length <= 22 Feet

D.A. Black Company
 2227 Village Lake Drive
 Charlotte, NC 28212
 704-537-1110